

**SOUND ABSORPTION COEFFICIENT  $\alpha_s$   
OF SUSPENDED WALL PANELS**

Test **8**  
Date **01/10/14**  
Station **ALPHA**  
AA45

**REQUESTER, MANUFACTURER** SAINT GOBAIN ECOPHON  
**NAME** Akusto Wall C/Texona 40 mm  
**FITNESS FOR PURPOSE** Unchecked  
**STANDARDS** EN ISO 354, EN ISO 11654, prEN 16487  
**CONFIGURATION** 50 mm overall depth of construction


**MAIN CHARACTERISTICS**

Dimensions in mm : 3000 x 3600  
Area in m<sup>2</sup> : 10.8  
Thickness in mm : 40  
Mass per unit area in kg/m<sup>2</sup>: 4.2  
Mounting type : E-50

**MEASUREMENT CONDITIONS**

**Empty room:** Temperature: 21.0°C  
Relative humidity: 67%  
**Room with sample:** Temperature: 21.0 °C  
Relative humidity: 67%

**RESULTS**

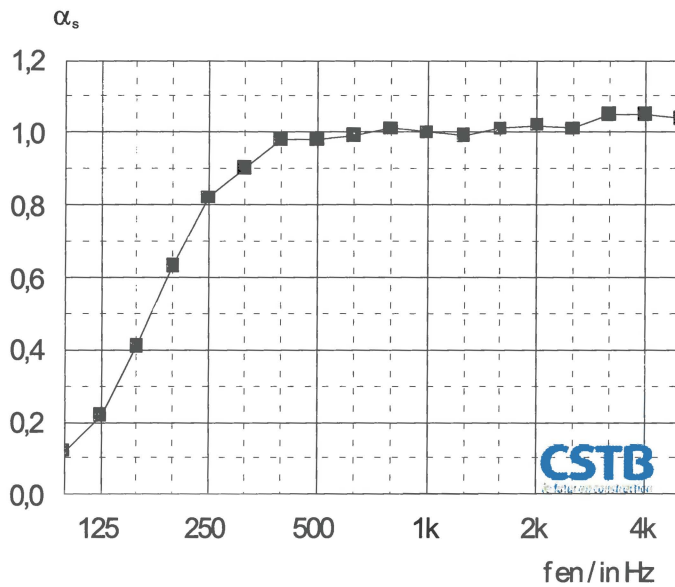

f	$\alpha_s$
100	0,12
125	0,22
160	0,41
200	0,63
250	0,82
315	0,90
400	0,98
500	0,98
630	0,99
800	1,01
1000	1,00
1250	0,99
1600	1,01
2000	1,02
2500	1,01
3150	1,05
4000	1,05
5000	1,04
Hz	

$\alpha_w = 1,00$   
classement / class: A

*It is strongly recommended to use this single number rating in combination with the complete sound absorption coefficient curve.*